

-ALL SEWER RETICULATION PIPES ARE Ø160, PE-100 SDR21 U.N.O.
-ALL SEWER HOUSE CONNECTION PIPES ARE Ø110 PE-100 SDR21 U.N.O.

LandPartners Pty Ltd, hereby certify that the vertical and horizontal locations and dimensions shown on this plan are a true and correct record and were located by survey.

 4118 31/07/2025

 Authorised Delegate Rego No. Date

 LandPartners Pty Ltd
 Registered Qld Surveyor Corporation

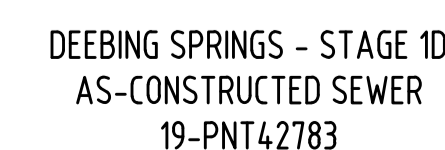
1. The information contained in this drawing / document is in compliance with approved drawings and design.
2. The new water and sewerage works defined by this drawing have been designed and constructed in accordance with the SEQ Code.
3. This represents an accurate record of as-constructed works.
4. I accept responsibility for the information contained in this drawing / document.

RPEQ (signature) _____ RPEQ No. _____ Date: _____

1:500

0 10 20 30 37

ALL DISTANCES IN METRES

[illegible]

SHEET 1 OF 1 SHEETS

DRAWING NO.
WC008495-01D-66-2